


LAFD FIRE PREVENTION BUREAU





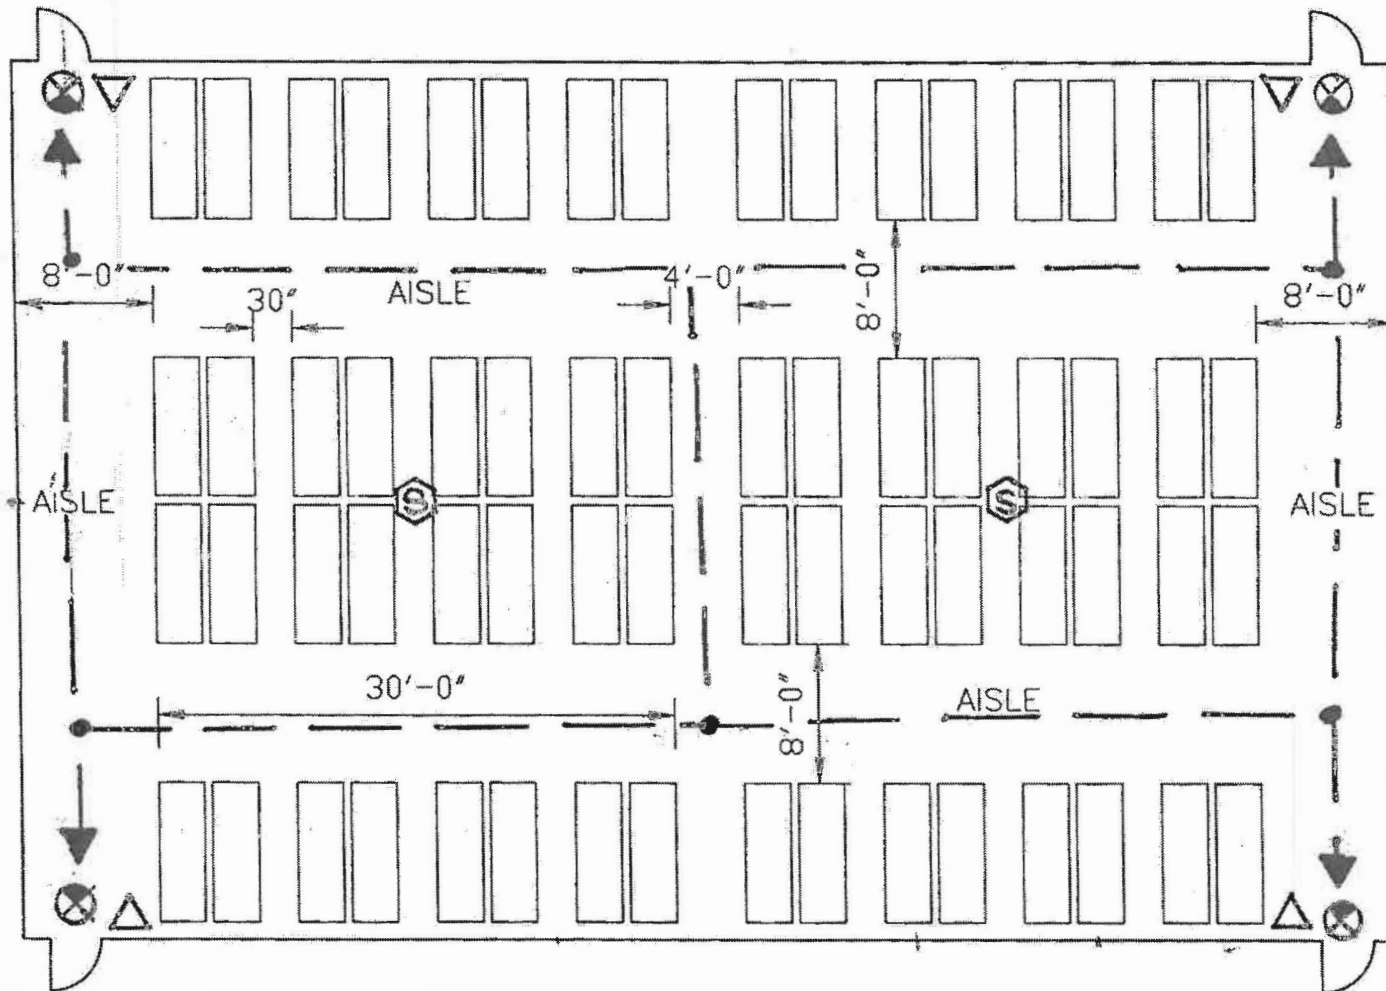

SAMPLE BED LAYOUT

NOTE:

- 30" MINIMUM BETWEEN BEDS
- 30'-0" MAXIMUM BETWEEN SIDE AISLES 8'-0" MINIMUM FOR MAIN AISLES
- 4'-0" MINIMUM FOR SIDE AISLES
- PROVIDE SMOKE ALARMS 30' ON CENTER
- PROVIDE PORTABLE FIRE EXTINGUISHERS ADJACENT TO EXIT DOORS
- PROVIDE EMERGENCY LIGHTING ALONG THE PATH OF EGRESS

LEGEND:

-  SMOKE ALARMS
-  PORTABLE FIRE EXTINGUISHERS
-  INTERNALLY ILLUMINATED EXIT SIGNS
-  EGRESS PATH